Portable Appliance Testing Report

Presented to

14-6 Annfield...


Portable Appliance Testing Commencement Date

20/08/2020

Tested by

ACM Electricians

Appliances tested for electrical safety in accordance with the IET code of practice for in service and inspection and testing of electrical equipment

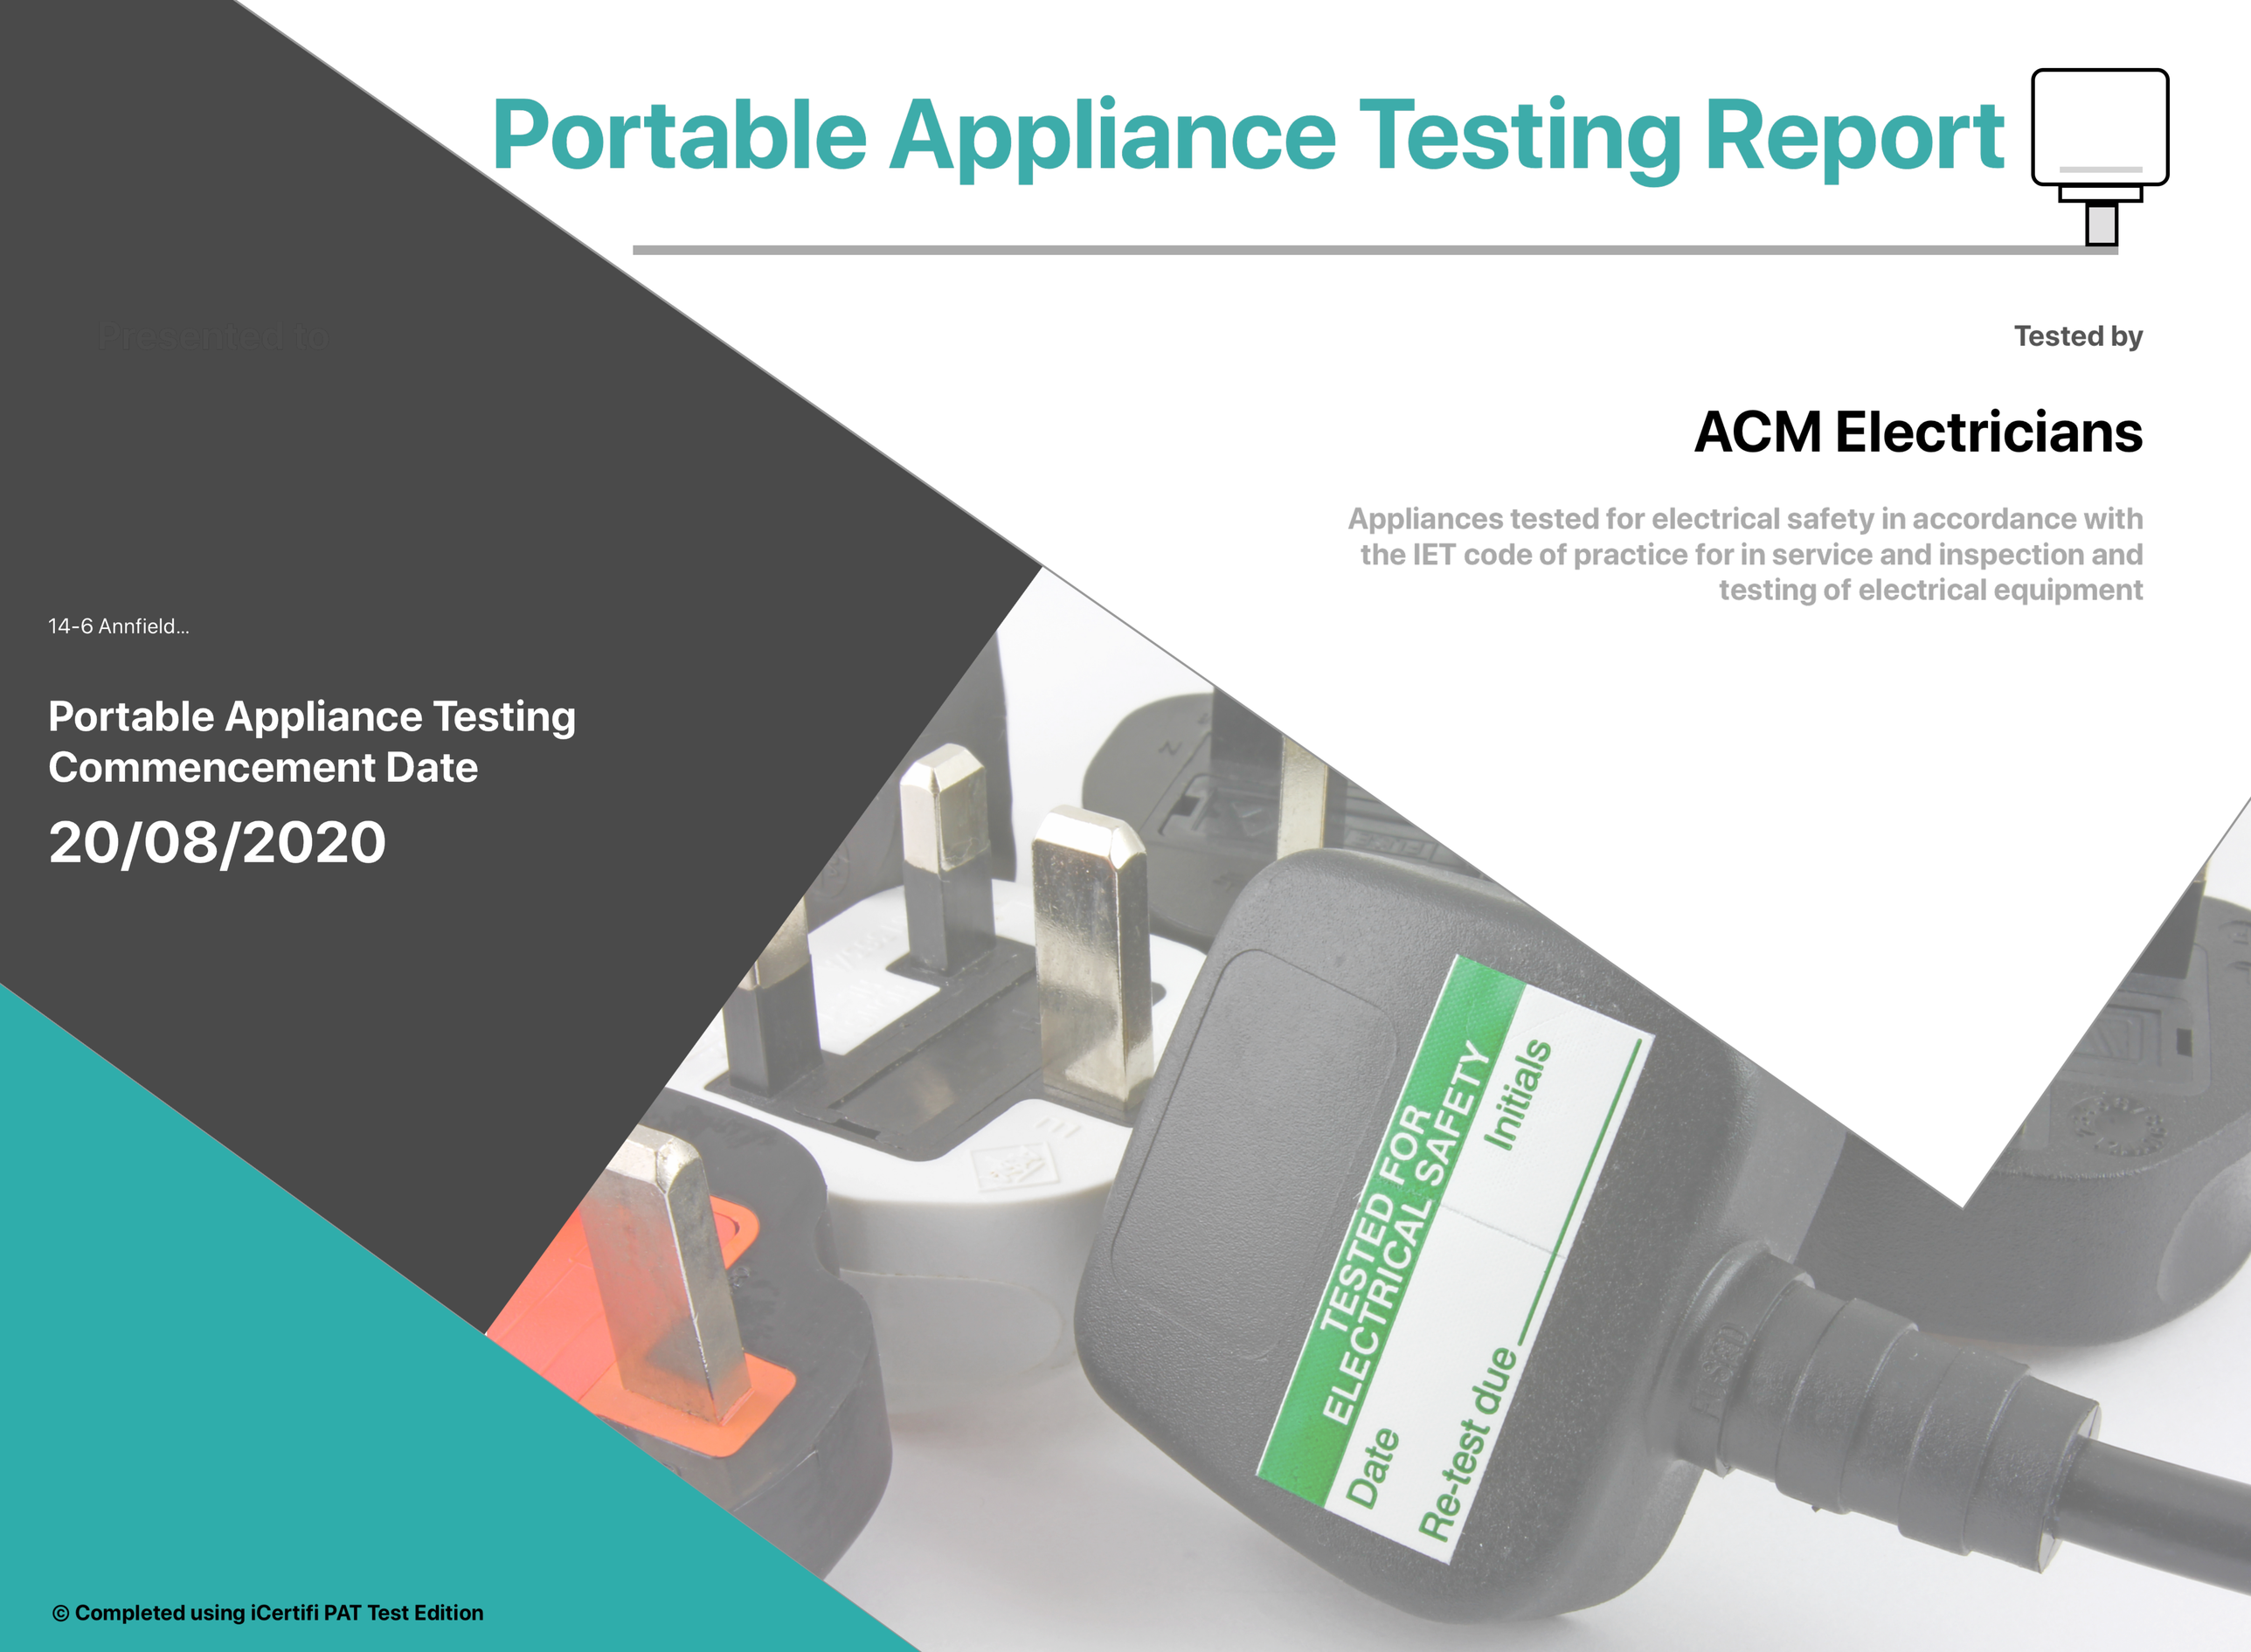

© Completed using iCertifi PAT Test Edition

Date Completed	20/08/2020	Certificate reference	PT65760276

Portable Appliance Test (PAT) Completion Certificate

DETAILS OF THE CLIENT

Client and address

Postcode:

ADDRESS OF TESTING

14-6 Annfield

Postcode:

*ANY LIMITATIONS AGREED ON TESTING

*If any, reasons and with whom agreed

The Premises Are:

Domestic	✓
Commerical	
Industrial	

DECLARATION

This is to certify the electrical appliances details in this certificate and record sheets have been tested for electrical safety in accordance with the IET code of practice for in service and inspection and testing of electrical equipment. It does not guarantee the correct operation of the appliance for any length of time. Users of the appliance should be aware of any fault or defect that may occur with future use. Any doubt regarding the safety or correct operation of the appliance, the device should be removed from service for further inspection by a competent person.

ENGINEER, NAME & SIGNATURE

Signature



Name

ANDREW MEIKLE

Date

20/08/2020

TESTING CARRIED OUT BY

Trading Title: **ACM Electricians**

15/2 Breadalbane Street
Edinburgh

Email

Web

Telephone No

Postcode: Eh65jj

Registration No: (if applicable)

Branch No: (if applicable)

PAT TESTER SERIAL NUMBER

Fluke 6500

NOTES

ANY FAILED APPLIANCES SHOULD BE REMOVED FROM SERVICE UNTIL THE DEFECT HAS BEEN RECTIFIED

APPLIANCE SUMMARY FOR 14-6 Annfield

Total Appliances	Appliances Passed	Appliances Failed
7	7	0

PORTABLE APPLIANCE REGISTER

Appliance number	Appliance	Class	Polarity	Location	Serial number/ID	Test Results				Visual check	Fuse rating (A)	Formal Visual Inspection (months)	Combined Inspection & Test (months)	Result	Repair Code
						Earth continuity test(Ω)	Insulation Resistance M(Ω)	Load test (kVA)	Earth Leakage Test (mA)						
1	**George Home Kettle**	2	N/A	Kitchen		N/A	N/A	2.9	0.16					**Pass**	
2	**Fridge Freezer**	2	N/A	Kitchen		N/A	292	0.247	0.10					**Pass**	
3	**Lamp**	2	N/A	Lounge		N/A	299	0.40	0.10					**Pass**	
4	**Heater**	2	N/A	Bedroom		N/A	299	2.6	0.14					**Pass**	
5	**Lamp**	2	N/A	Bedroom		N/A	299	0.33	0.10					**Pass**	
6	**Morph Richards Iron**	1	N/A	Kitchen		0.06	299	1.1	0.10					**Pass**	
7	**Hoover**	2	N/A	Various		N/A	299	1.0	0.10					**Pass**	

Repair Codes:

A = Replace plug
B = Rewire plug
C = Fit BS1361 sleeved plug
D = Fit rubber plug
E = Fit inline switch
F = Replace IEC lead
G = Replace lead
H = Other

Completed using iCertifi electrical certificates on iOS

Certificate Reference

PT65760276

PAT Test
Completion Certificate

Presented To

This is to certify the electrical appliances on the premises for the above named have been tested for electrical safety in accordance with the IET code of practice for in service and inspection and testing of electrical test equipment

Date 20/08/2020

ANDREW MEIKLE

Tested by

Engineers Signature

© iCertifi electrical certificates on iOS